

Topic 6: Superconductivity, Networks and System Integration

Graph-theoretic Model for Observability in Multi-carrier Energy Distribution Networks (MEDNs)

Sören Hohmann, Heiko Maaß, Carina Mieth, Martin Pfeifer, Dorothea Wagner, Franziska Wegner

Multi-carrier Networks

Energy networks: electricity (e), heat (h), natural gas (g)
+
Decentralized energy converters (e.g. CHP, P2X)
↓
Multi-carrier Energy Distribution Network (MEDN) [1]

Observability

An energy network is *observable* if all operational variables are determinable, based on the topology of the network, and the types and locations of the measurement points [2].

Monitoring

Monitoring of operational variables is essential as network constraints have to be met by the MEDN control

- e: voltage and current limits
- h: pressure, temperature and volume flow limits
- g: pressure and volume flow limits

Key Questions

- Q1. How can we include the network topology and the operational variables in a unified MEDN model?
- Q2. Based on that model, how can we determine observability in MEDNs?




Model

Steady state modeling as a graph $M = (V, A)$

- V : set of vertices
- $V_i \subseteq V$: set of transfer vertices of carrier $i \in [1, k]$
- $V_C \subseteq V$: set of converters (e.g. CHP, P2X)
- $V_T \subseteq V$ set of disturbances
- $A \subseteq \binom{V}{2}$: set of edges

Vertices and edges are related to *effort* and *flow variables*:

	Electricity	Natural Gas	Heat
effort e	voltage U	pressure p	pressure p
flow f	current I	flow Q	flow Q

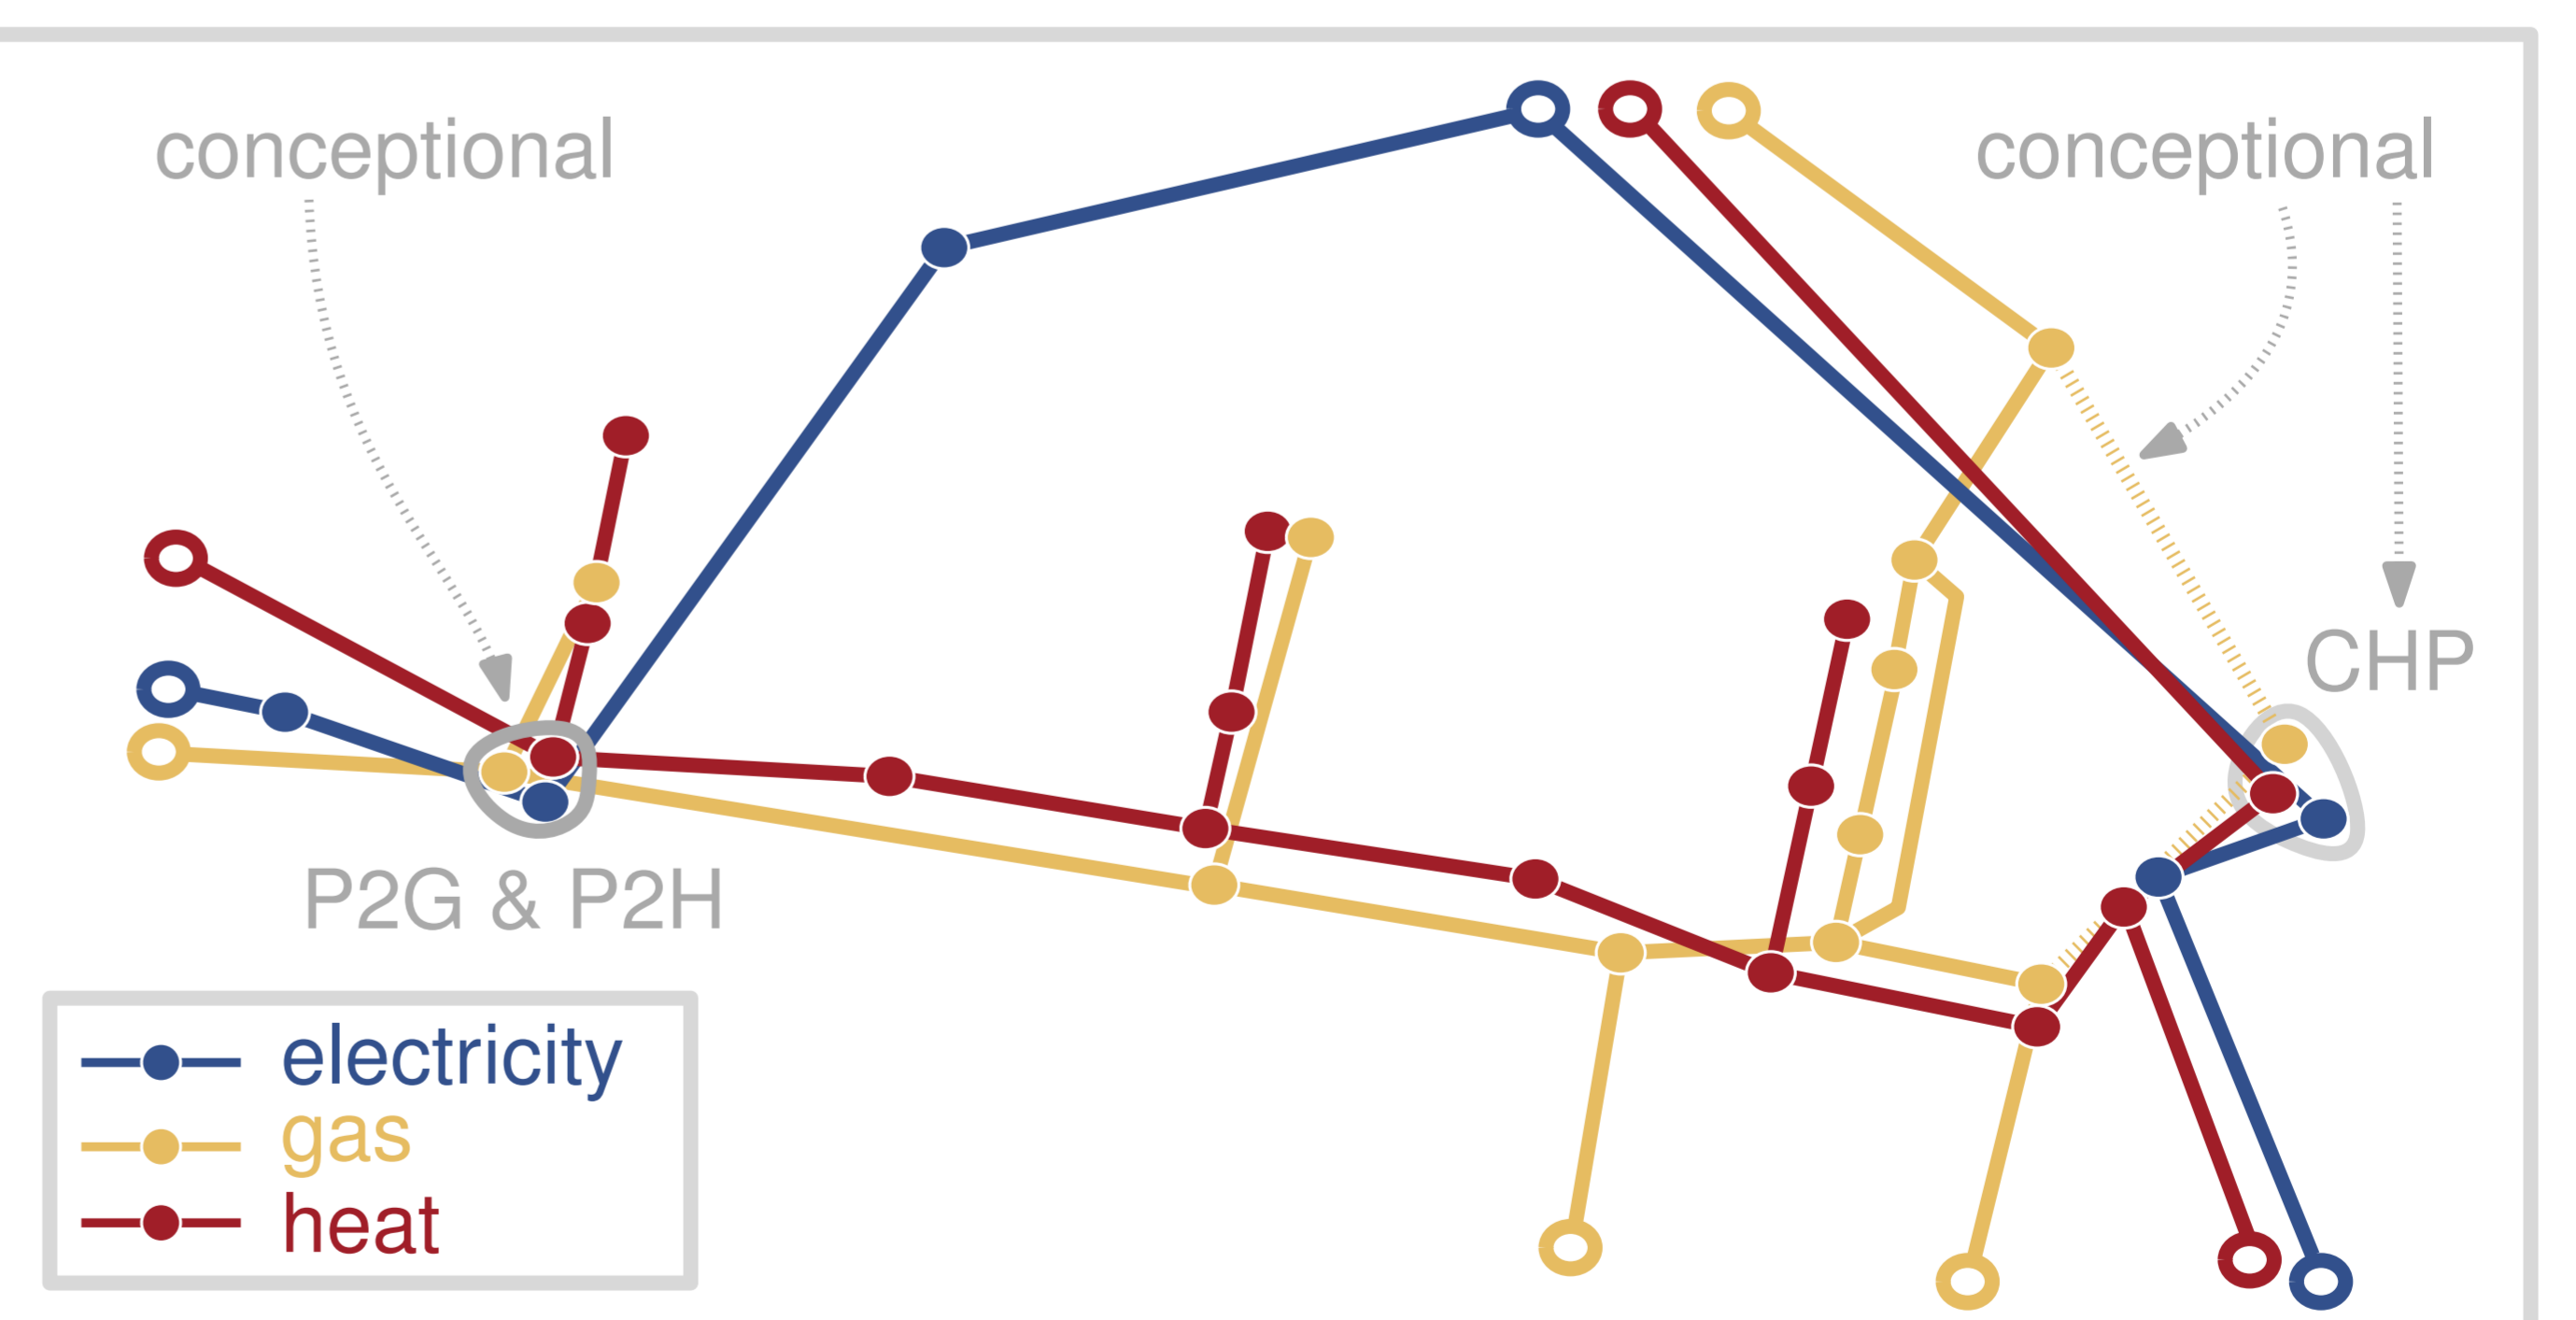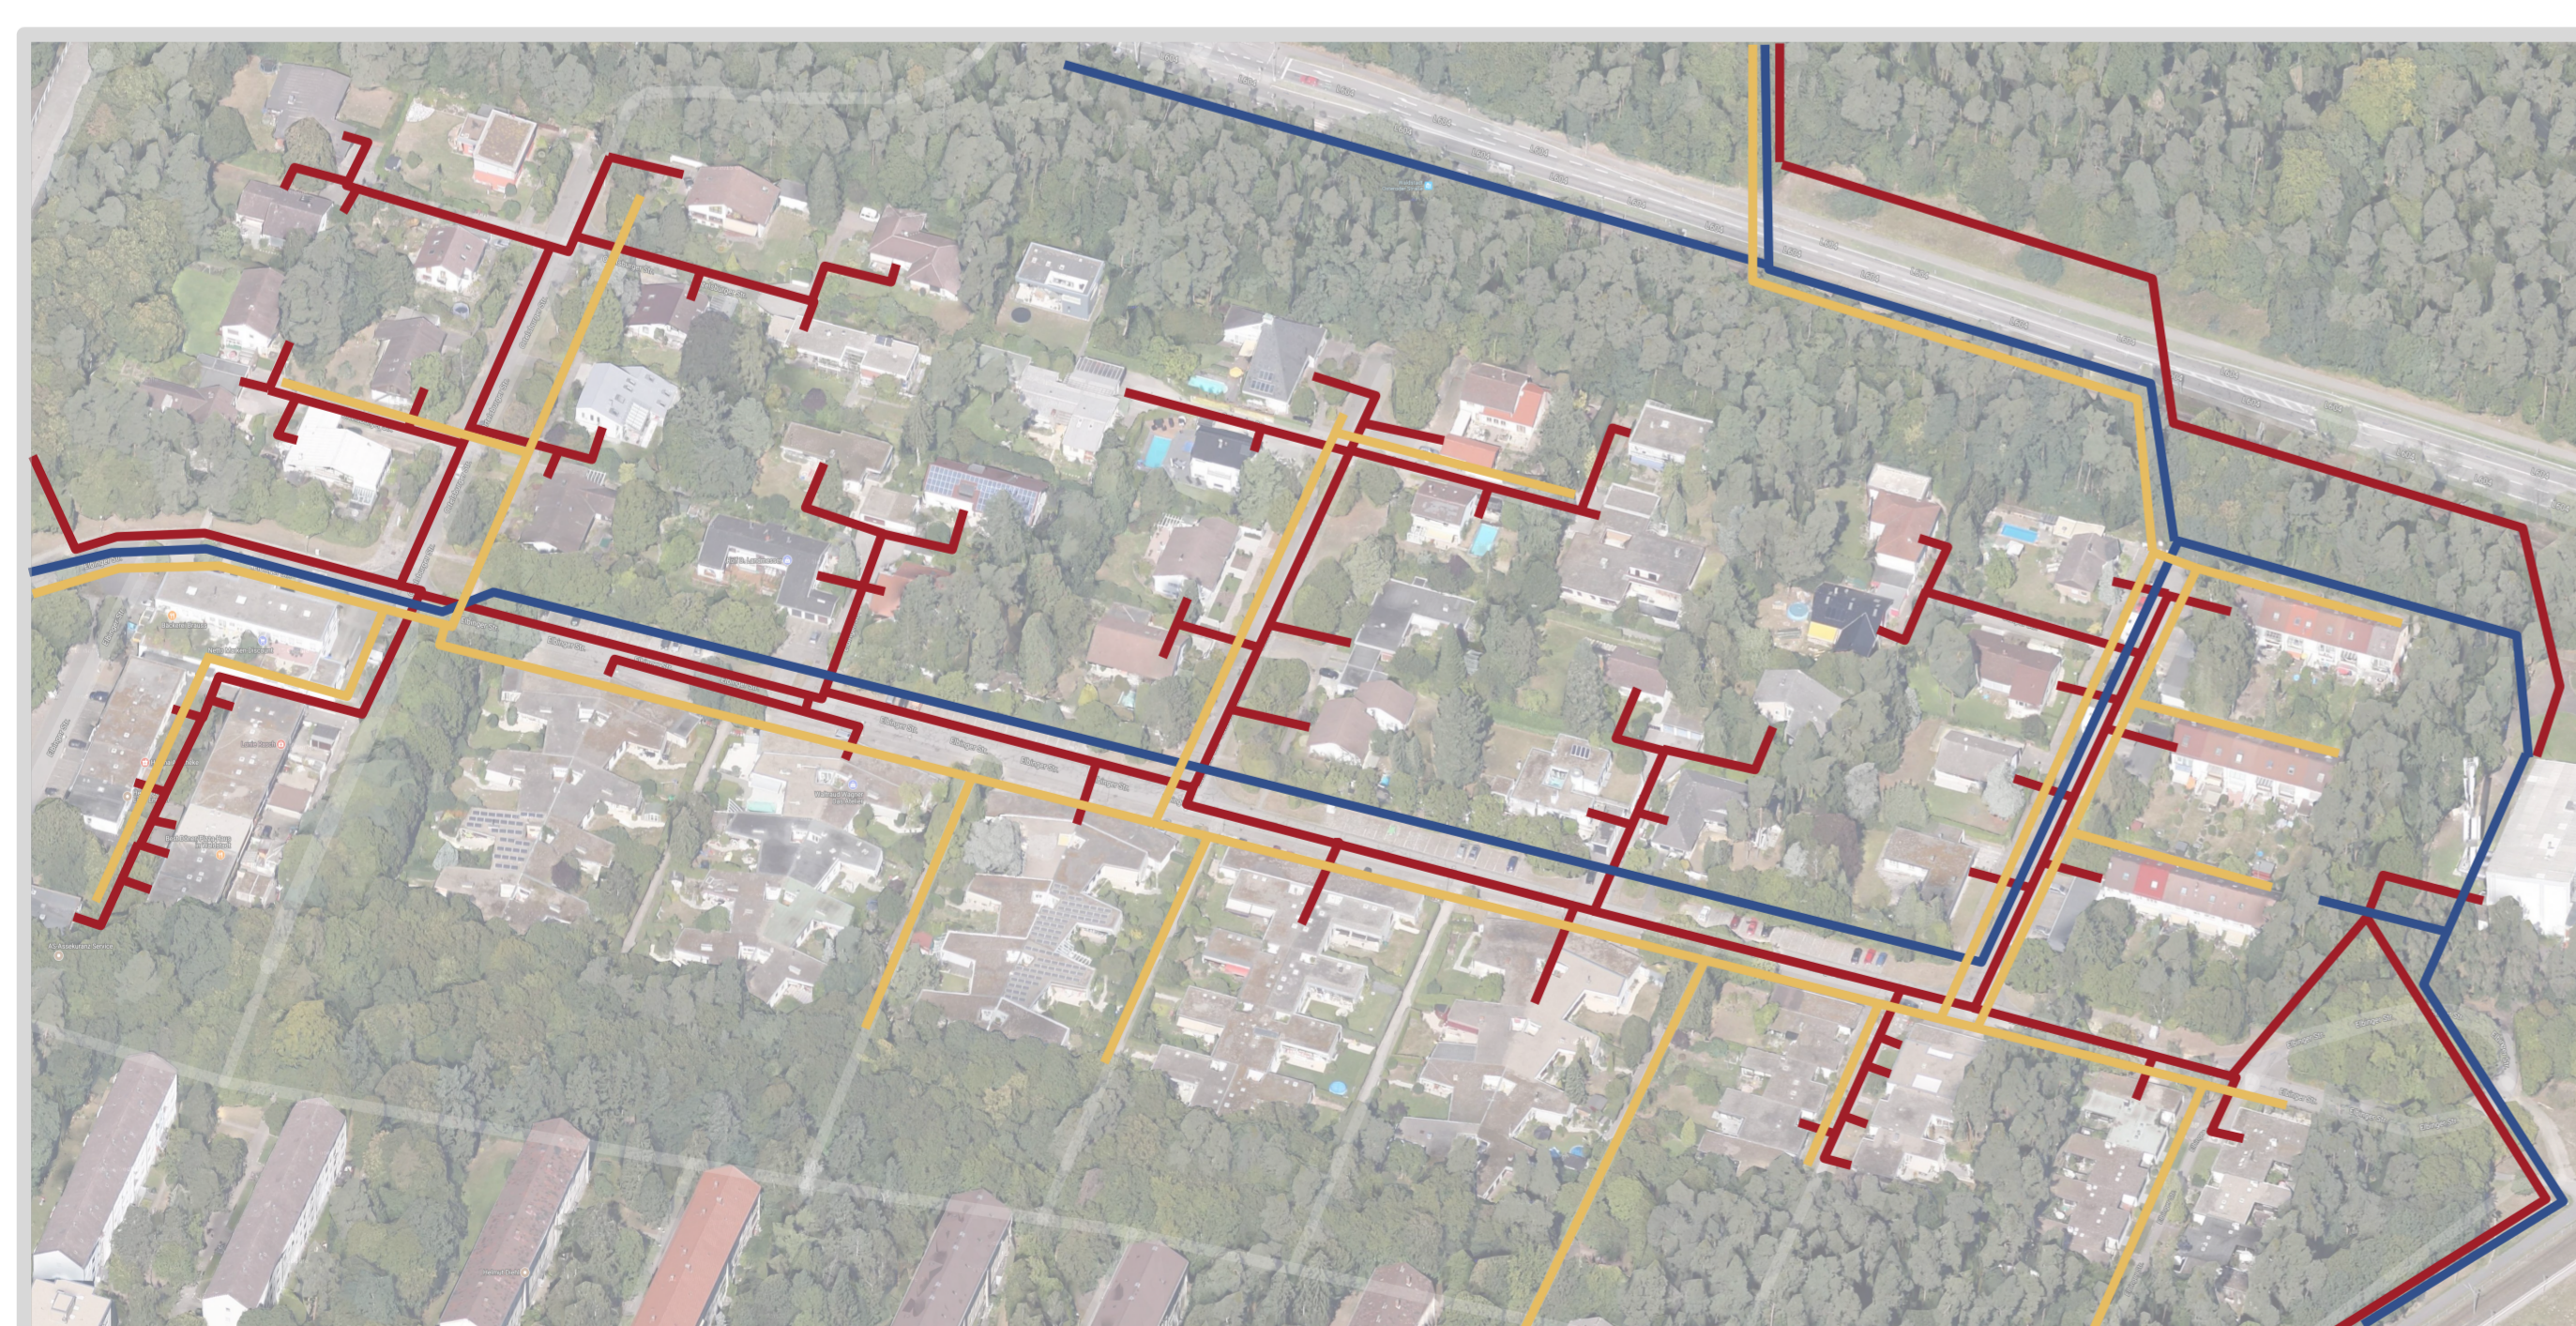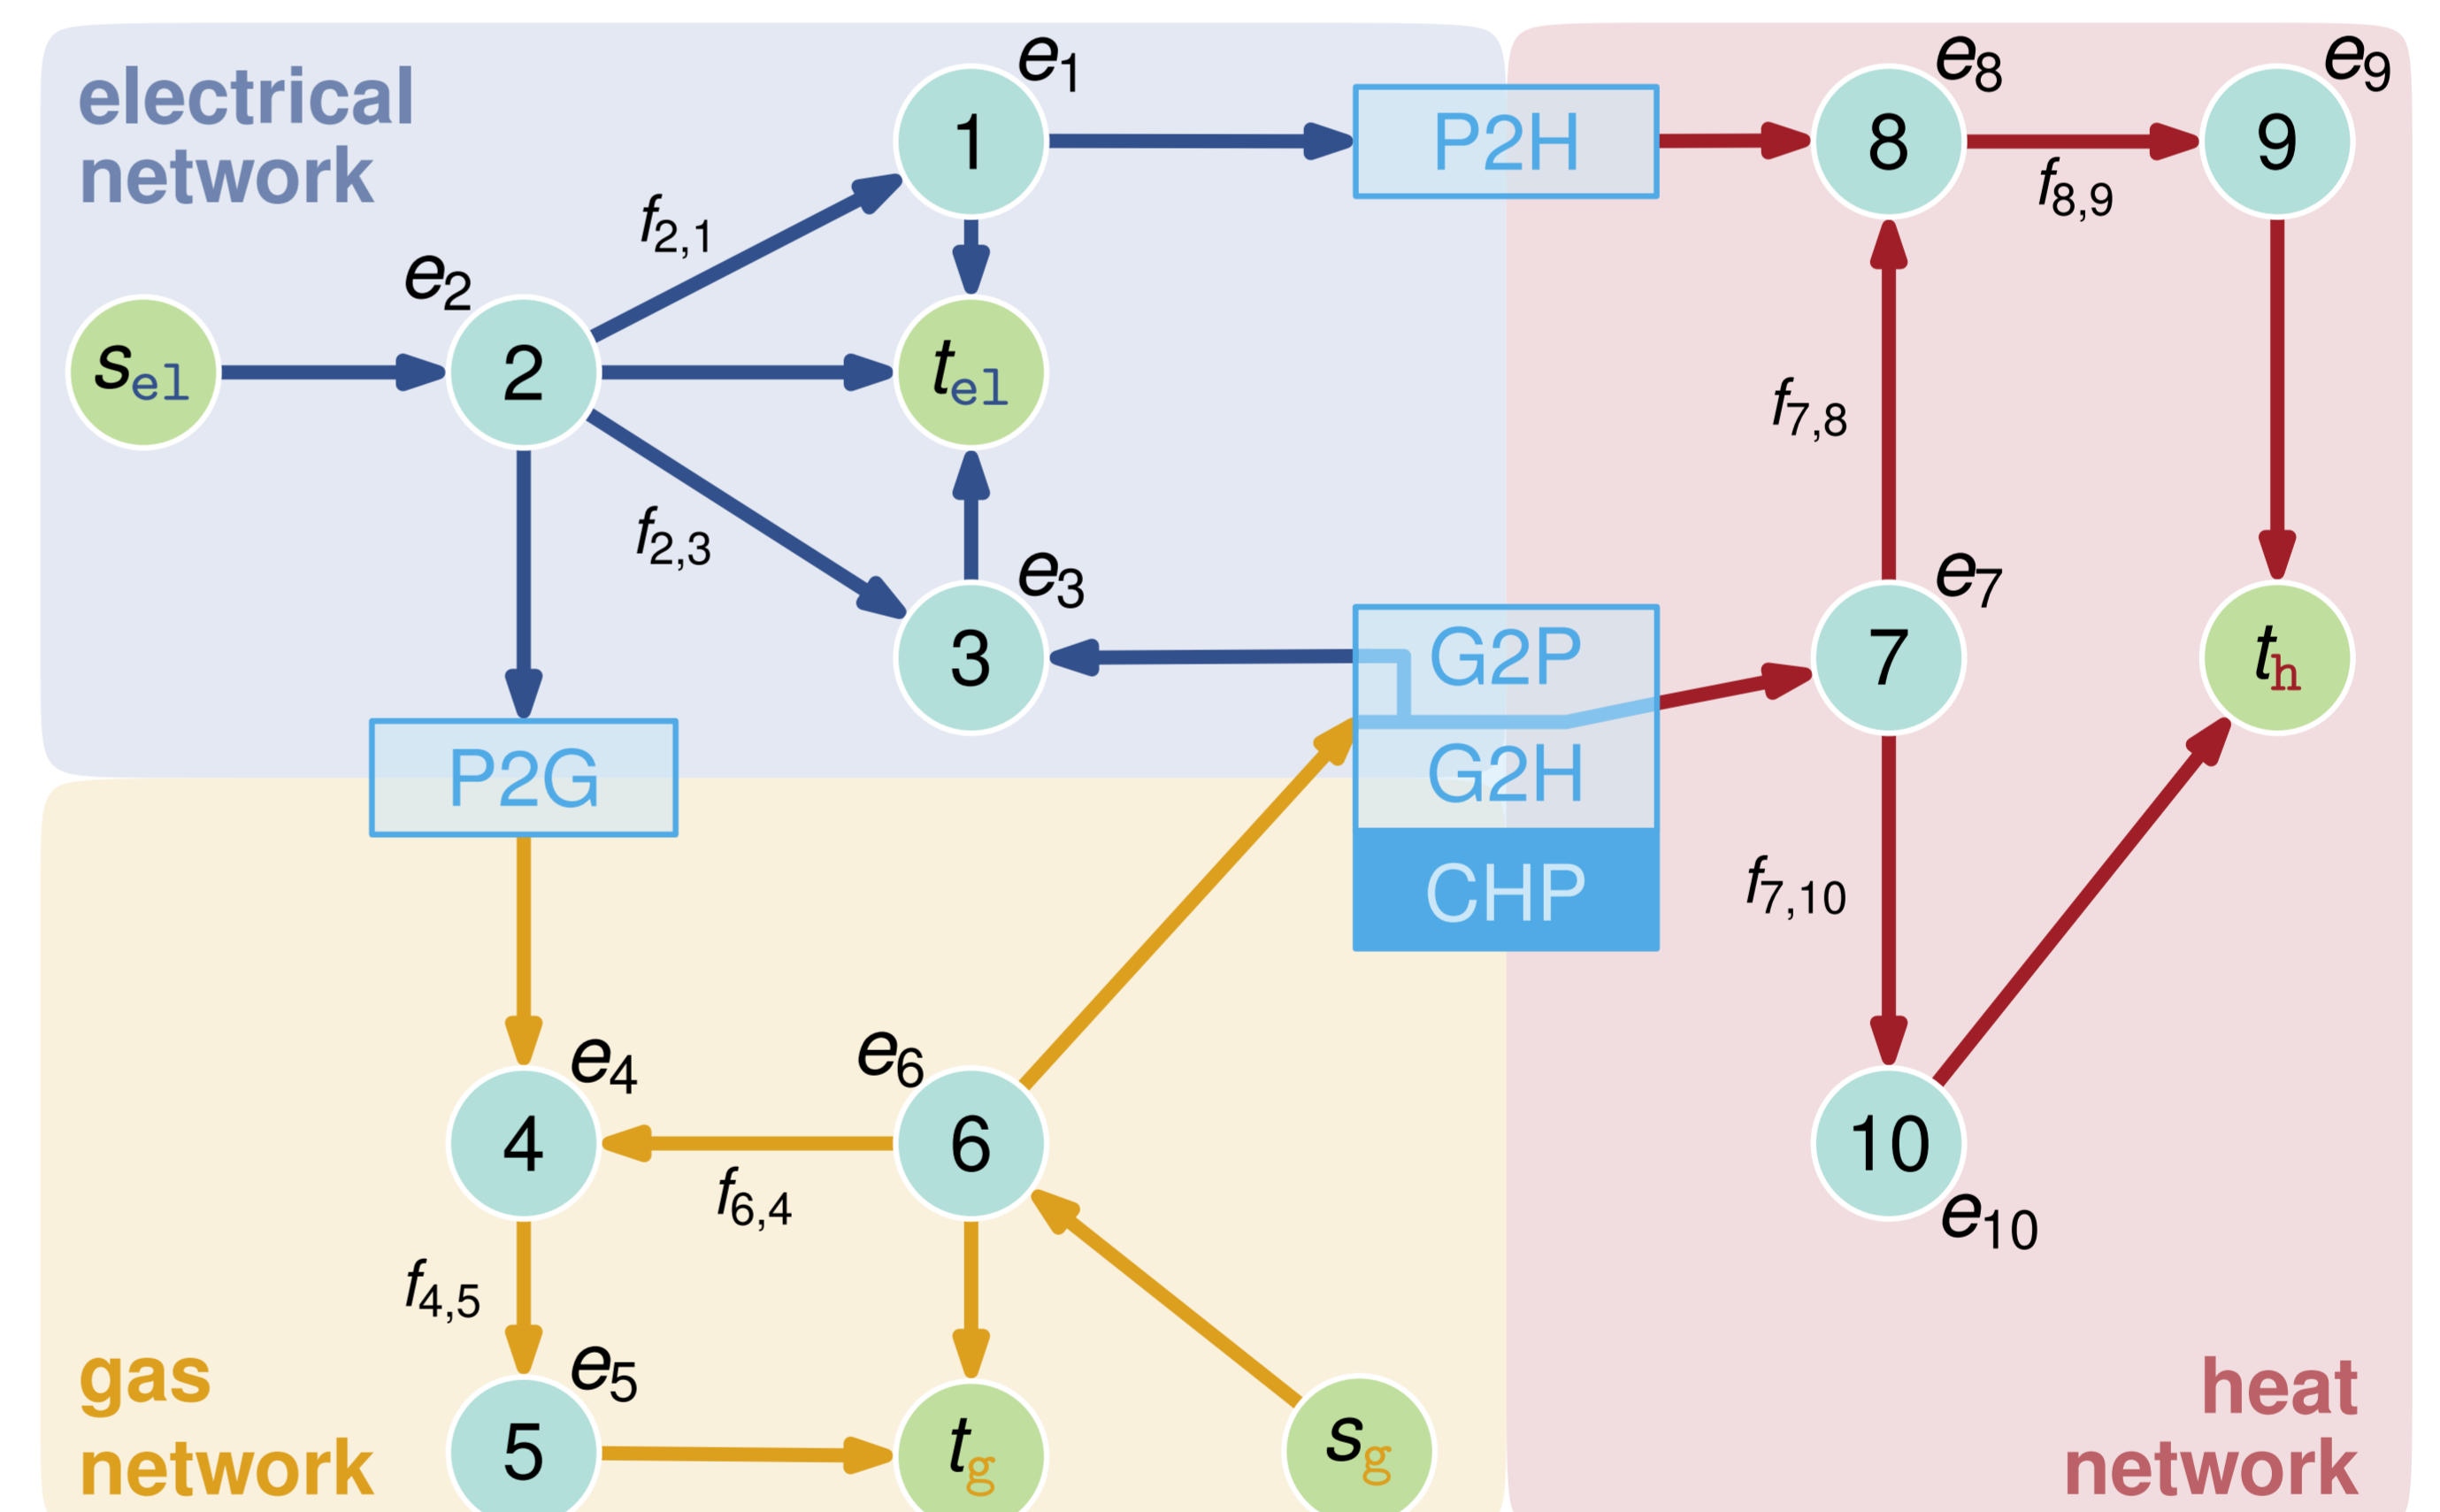

Future Work

- Derivation of an observability criterion for MEDNs
- Determination of a cost-optimal sensor placement

Literature

- [1] Geidl and Andersson: A modeling and optimization approach for multiple energy carrier power flow. In: IEEE Power Tech, Russia (2005)
- [2] Baldwin et al.: Power system observability with minimal phasor measurement placement. IEEE Transactions on Power Systems 8(2), 707–715 (1993)